



Hans-Joachim Kretzschmar and Katja Knobloch


**Supplementary Backward Equations for the  
 Industrial Formulation IAPWS-IF97 of Water and Steam  
 for Fast Calculations of Heat Cycles, Boilers,  
 and Steam Turbines**

**Contents**

- Structure of IAPWS-IF97 and Supplementary Backward Equations
- Backward and Boundary Equations for Functions of  $(p, h)$
- Backward and Boundary Equations for Functions of  $(p, s)$
- Backward and Boundary Equations for Functions of  $(h, s)$
- Backward Equations for Functions of  $(p, T)$  in Region 3
- Computing Times in Comparison with IAPWS-IF97 Fundamental Equations

14th ICPWS, Kyoto, 2004

**IAPWS Industrial Formulation 1997 for the  
 Thermodynamic Properties of Water and Steam  
 IAPWS-IF97**

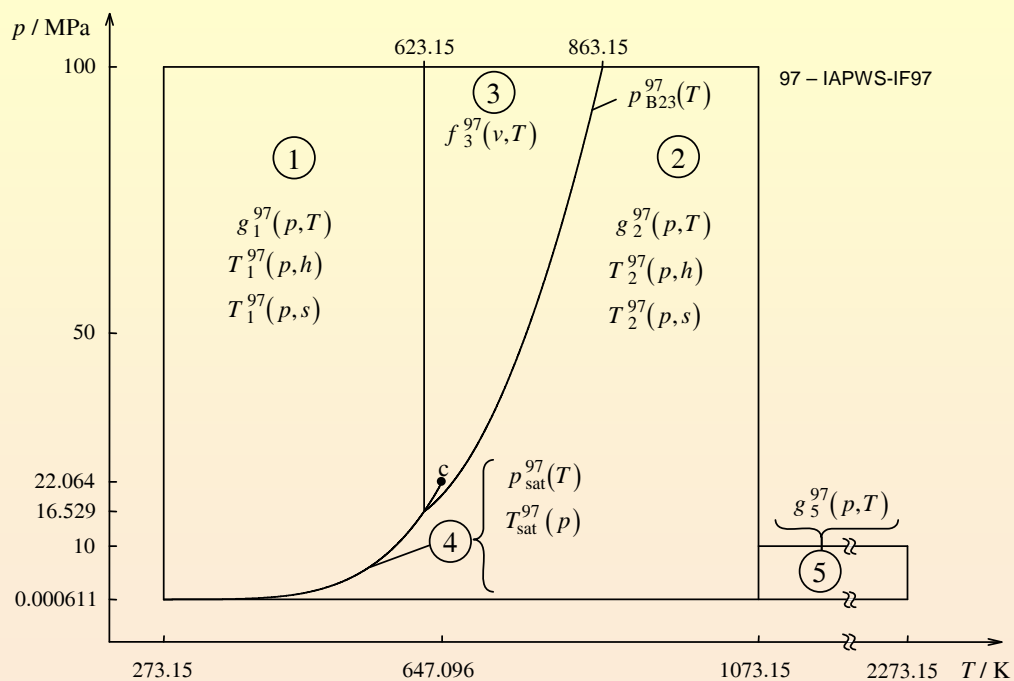

14th ICPWS, Kyoto, 2004

**Working Group  
Industrial Requirements  
and Solutions  
(IRS)**

**Working Group  
Thermophysical Properties  
of Water and Steam  
(TPWS)**

**Task Group  
on Supplementary Backward Equations  
for IAPWS-IF97  
and Contributors**

J. R. Cooper  
A. Dittmann  
D. G. Friend  
A. H. Harvey  
K. Knobloch  
H.-J. Kretzschmar (chair)  
R. Mareš  
R. Span  
I. Stöcker  
W. Wagner

**Evaluation Task Group**

J. Gallagher  
K. Miyagawa (chair)  
N. Okita  
I. Weber

14th ICPWS, Kyoto, 2004

**Supplementary Release**

**Equations**

**Status**

**IAPWS-IF97-S01:**

Supplementary Release on Backward Equations for Pressure as a Function of Enthalpy and Entropy  $p(h,s)$  to the IAPWS Industrial Formulation 1997 for the Thermodynamic Properties of Water and Steam.

$p_1(h,s)$   
 $p_2(h,s)$

adopted  
in 2001

**IAPWS-IF97-S03:**

Supplementary Release on Backward Equations for the Functions  $T(p,h)$ ,  $v(p,h)$  and  $T(p,s)$ ,  $v(p,s)$  for Region 3 of the IAPWS Industrial Formulation 1997 for the Thermodynamic Properties of Water and Steam, 2003.

$T_3, v_3(p,h)$   
 $T_3, v_3(p,s)$

adopted  
in 2003

**IAPWS-IF97-S03rev (Draft):**

Revised Supplementary Release on Backward Equations for the Functions  $T(p,h)$ ,  $v(p,h)$  and  $T(p,s)$ ,  $v(p,s)$  for Region 3 of the IAPWS Industrial Formulation 1997 for the Thermodynamic Properties of Water and Steam.

$T_3, v_3(p,h)$   
 $T_3, v_3(p,s)$   
 $p_{3sat}(h)$   
 $p_{3sat}(s)$

evaluated,  
to be adopted  
in 2004

**IAPWS-IF97-S04 (Draft):**

Supplementary Release on Backward Equations  $p(h,s)$  for Region 3, Equations as a Function of  $h$  and  $s$  for the Region Boundaries, and an Equation  $T_{sat}(h,s)$  for Region 4 of the IAPWS Industrial Formulation 1997 for the Thermodynamic Properties of Water and Steam.

$p_3(h,s)$   
 $T_{sat}(h,s)$   
 $h'(s)$ ,  $h''(s)$   
 $h_{B13}(s)$   
 $T_{B23}(h,s)$

evaluated,  
to be adopted  
in 2004

Supplementary Release on Backward Equations for Specific Volume as a Function of Pressure and Temperature  $v(p,T)$  for Region 3 of the IAPWS Industrial Formulation 1997 for the Thermodynamic Properties of Water and Steam. (Draft)

$v_3(p,T)$

to be submitted in  
2004  
(adoption  
planned in 2005)

14th ICPWS, Kyoto, 2004

## Requirements on Backward Equations

### 1. Extremely high numerical consistency

- Deviation between the backward equation and the relating fundamental equation
- Corresponds to iteration accuracy otherwise used in numerical calculations of process modeling
- Determined by IAPWS based on an international survey in industry

Example: Backward equations  $T(p, h)$


$$|\Delta T| = |T - T(p, h)|$$

where  $h(p, T)$  – derived from  $g(p, T)$


**Problem:** The numerical consistency is more than one magnitude higher than accuracy of the properties themselves

### 2. Calculation of the backward equations should be much faster than the corresponding iterations of the fundamental equations

## Supplementary Backward Equations for IAPWS-IF97

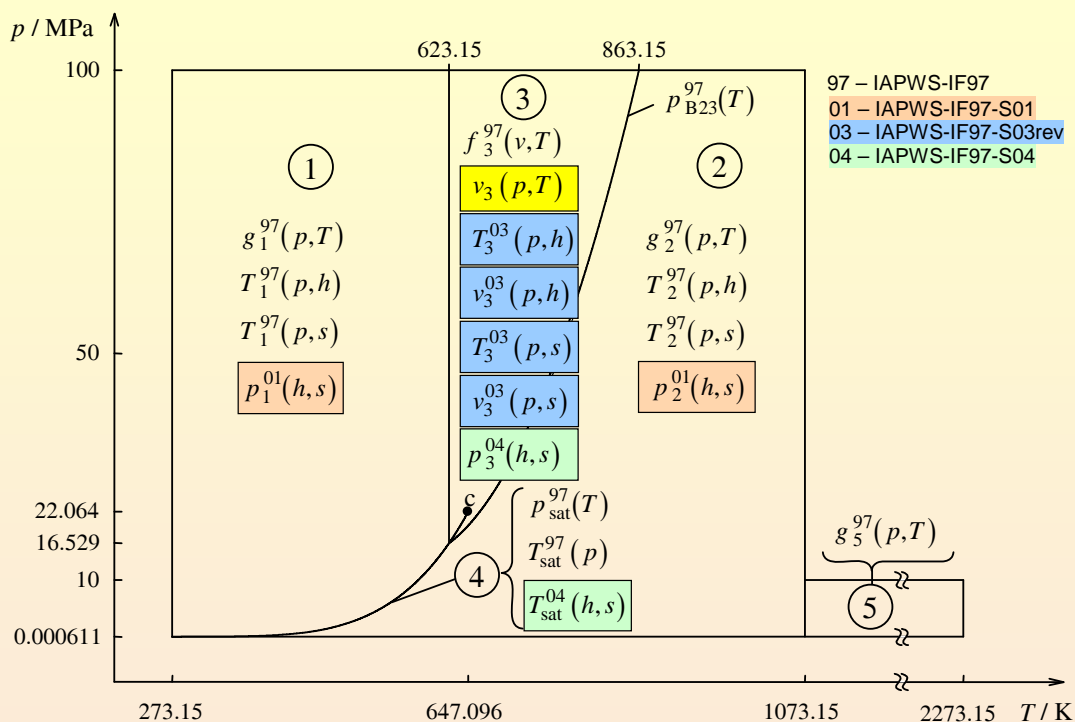

## Backward and Boundary Equations for Functions of Pressure and Enthalpy ( $p, h$ )

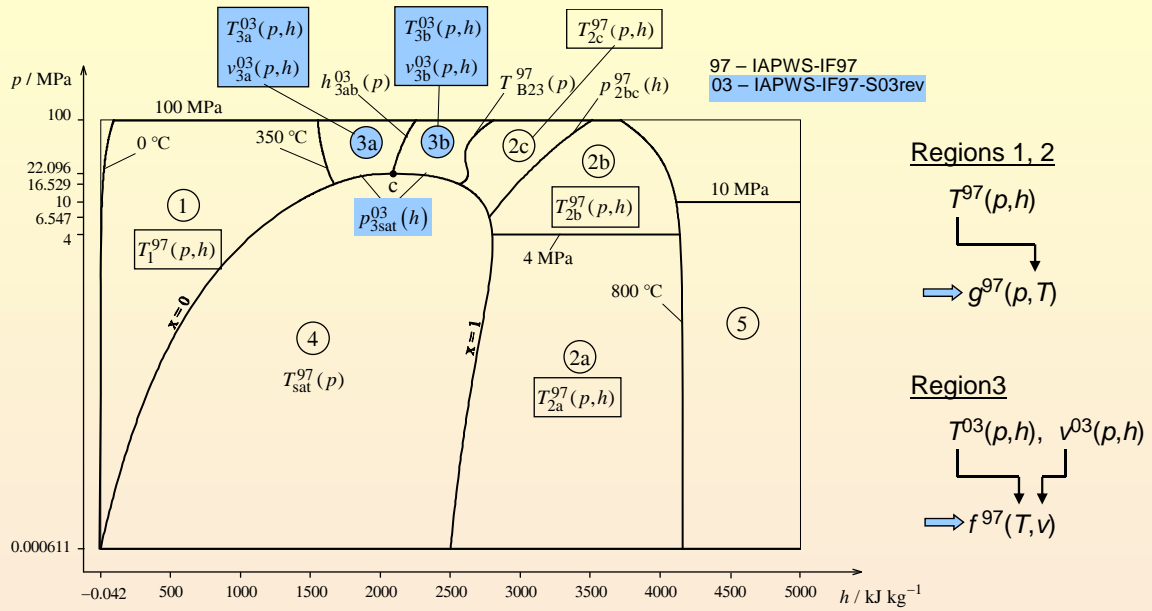

Regions 1, 2

$$T^{97}(p, h) \rightarrow g^{97}(p, T)$$

Region 3

$$T^{03}(p, h), v^{03}(p, h) \rightarrow f^{97}(T, v)$$

14th ICPWS, Kyoto, 2004

## Backward Equations $T(p, h)$ and $v(p, h)$

Structure


$$\frac{T(p, h)}{T^*} = \sum_{i=1}^N n_i \left( \frac{p}{p^*} + a \right)^{l_i} \left( \frac{h}{h^*} + b \right)^{j_i} \quad \frac{v(p, h)}{v^*} = \sum_{i=1}^N n_i \left( \frac{p}{p^*} + a \right)^{l_i} \left( \frac{h}{h^*} + b \right)^{j_i}$$

Numerical consistency

Equation	N	a	b	$ \Delta T _{\text{tol}}$ mK	$ \Delta T _{\text{max}}$ mK
$T_1^{97}(p, h)$	20	0	1	25	23.6
$T_{2a}^{97}(p, h)$	34	0	-2.1	10	9.3
$T_{2b}^{97}(p, h)$	38	-2	-2.6	10	9.6
$T_{2c}^{97}(p, h)$	23	25	-1.8	25	23.7
$T_{3a}^{03}(p, h)$	31	0.24	-0.615	25	23.6
$T_{3b}^{03}(p, h)$	33	0.298	-0.720	25	19.6
Equation	N	a	b	$ \Delta v/v _{\text{tol}}$ %	$ \Delta v/v _{\text{max}}$ %
$v_{3a}^{03}(p, h)$	32	0.128	-0.727	0.01	0.0080
$v_{3b}^{03}(p, h)$	30	0.0661	-0.72	0.01	0.0095


14th ICPWS, Kyoto, 2004

## Backward and Boundary Equations for Functions of Pressure and Entropy ( $p, s$ )

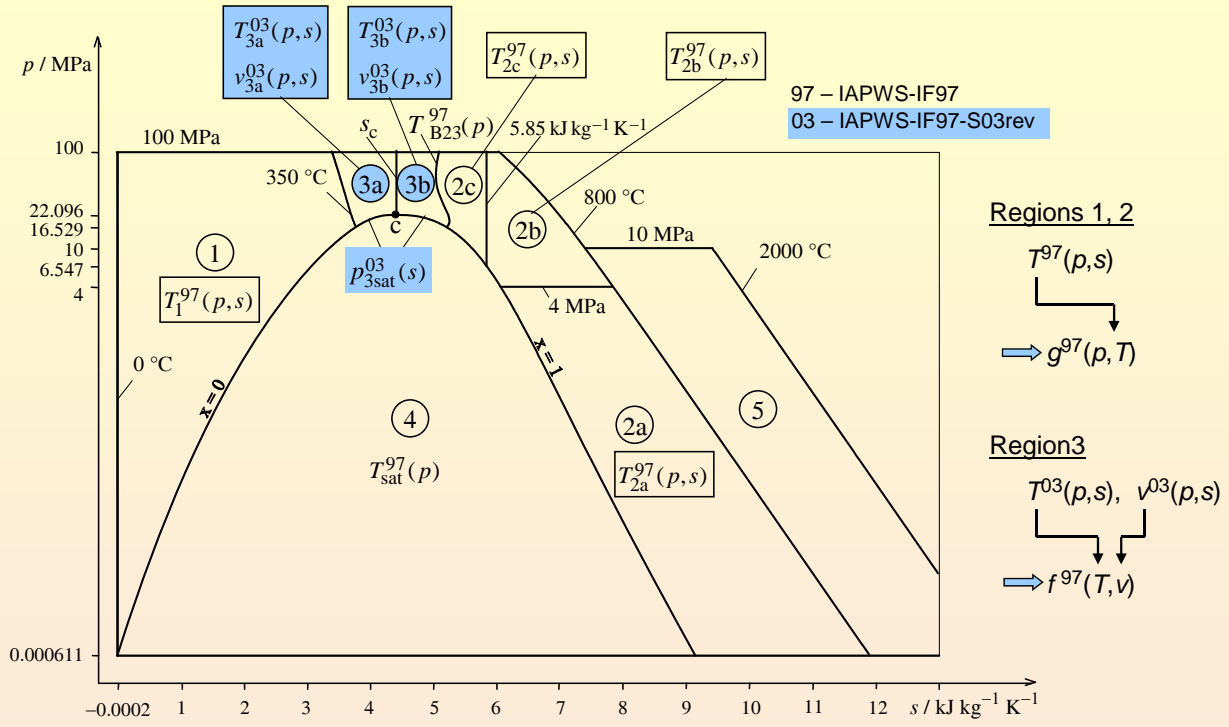

14th ICPWS, Kyoto, 2004

## Backward Equations for Functions of Enthalpy and Entropy ( $h, s$ )

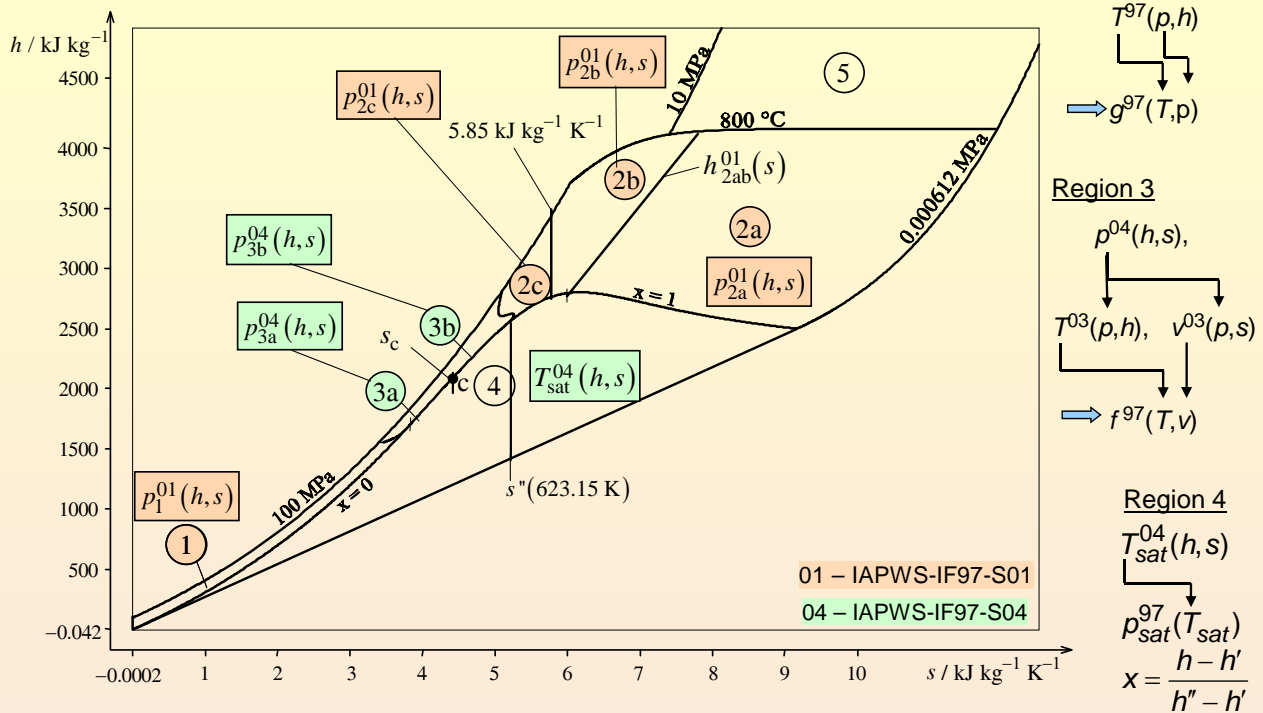

14th ICPWS, Kyoto, 2004

Regions 1, 2

$$T^{97}(p, s) \rightarrow g^{97}(p, T)$$

Region 3

$$T^{03}(p, s), v^{03}(p, s) \rightarrow f^{97}(T, v)$$

Regions 1, 2

$$p^{01}(h, s) \rightarrow T^{97}(p, h) \rightarrow g^{97}(T, p)$$


Region 3

$$p^{04}(h, s), p^{03}(p, h), v^{03}(p, s) \rightarrow f^{97}(T, v)$$

Region 4

$$T_{sat}^{04}(h, s) \rightarrow p_{sat}^{97}(T_{sat}) \rightarrow x = \frac{h - h'}{h'' - h'}$$

## Boundary Equations for Functions of Enthalpy and Entropy ( $h, s$ )

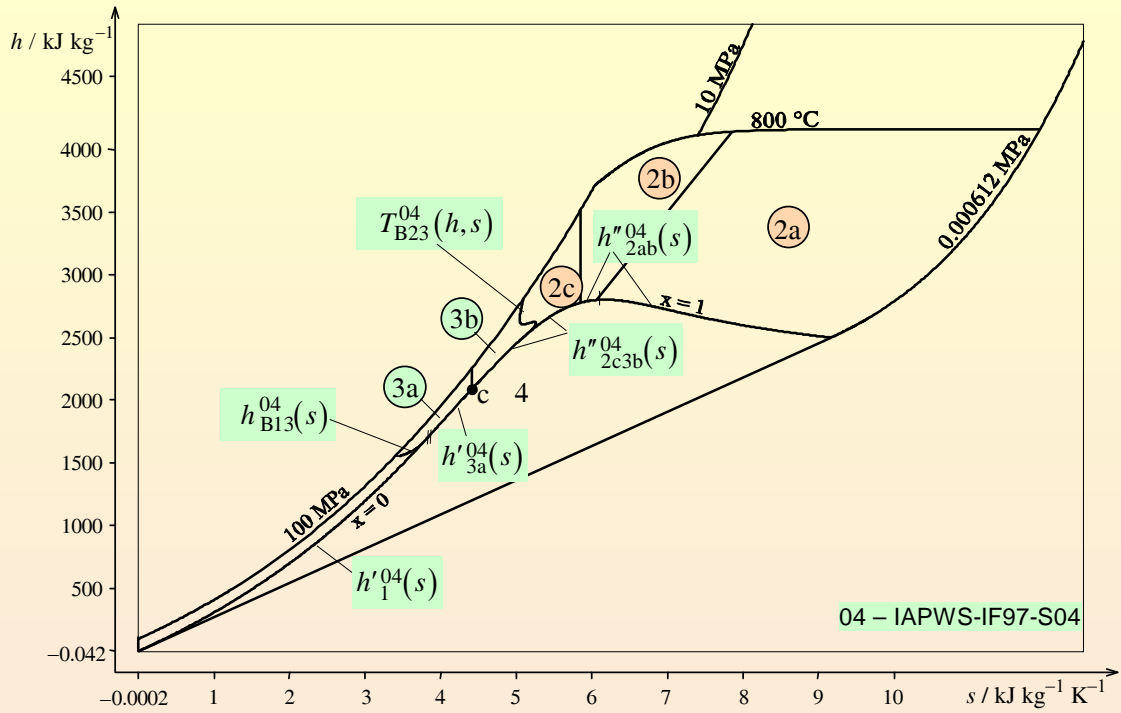

14th ICPWS, Kyoto, 2004

## Backward Equations $p(h, s)$ and $T_{\text{sat}}(h, s)$

### Structure

$$\frac{p(h, s)}{p^*} = \left[ \sum_{i=1}^N n_i \left( \frac{h}{h^*} + a \right)^{l_i} \left( \frac{s}{s^*} + b \right)^{j_i} \right]^c$$

$$\frac{T_{\text{sat}}(h, s)}{T^*} = \sum_{i=1}^{36} n_i \left( \frac{h}{h^*} - 0.119 \right)^{l_i} \left( \frac{s}{s^*} - 1.07 \right)^{j_i}$$

### Numerical consistency

Equation	$ \Delta p/p _{\text{tol}}$ %	$ \Delta p/p _{\text{max}}$ %	$ \Delta T _{\text{tol}}$ mK	$ \Delta T _{\text{max}}$ mK	$ \Delta v/v _{\text{tol}}$ %	$ \Delta v/v _{\text{max}}$ %
$p_1^{01}(h, s)$ $p \leq 2.5 \text{ MPa}$	0.60	0.55	25	24.0		
$p_1^{01}(h, s)$ $p > 2.5 \text{ MPa}$	15 kPa	14 kPa				
$p_{2a}^{01}(h, s)$	0.0035	0.0029	10	9.7		
$p_{2b}^{01}(h, s)$	0.0035	0.0034	10	9.8		
$p_{2c}^{01}(h, s)$	0.0088	0.0063	25	24.9		
$p_{3a}^{04}(h, s)$	0.01	0.0070	25	23.7	0.01	0.0097
$p_{3b}^{04}(h, s)$	0.01	0.0084	25	22.4	0.01	0.0095
Equation	$ \Delta T _{\text{tol}}$ mK	$ \Delta T _{\text{max}}$ mK	$ \Delta p/p _{\text{tol}}$ %	$ \Delta p/p _{\text{max}}$ %	$ \Delta x _{\text{tol}}$ -	$ \Delta x _{\text{max}}$ -
$T_{\text{sat}}^{04}(h, s)$ $s \leq 5.85 \text{ kJ kg}^{-1} \text{K}^{-1}$	25	0.86	0.0088	0.0034	$4.4 \times 10^{-6}$	$0.57 \times 10^{-6}$
$T_{\text{sat}}^{04}(h, s)$ $s > 5.85 \text{ kJ kg}^{-1} \text{K}^{-1}$	10	0.67	0.0035	0.0029	$0.64 \times 10^{-6}$	$0.25 \times 10^{-6}$

14th ICPWS, Kyoto, 2004

## Computing Time in Comparison with IAPWS-IF97 Fundamental Equations

### Computing Time Ratio (CTR)

$$CTR = \frac{\text{Computing time of fundamental eq.}}{\text{Computing time of backward eq.}}$$

#### Backward Equations

Function	Reg.	Backward Equation(s)	CTR
(p,h)	1	$T_1^{97}(p,h)$	5
	2	$T_2^{97}(p,h)$	6
	3	$T_3^{03}(p,h)$ & $v_3^{03}(p,h)$	16
(p,s)	1	$T_1^{97}(p,s)$	6
	2	$T_2^{97}(p,s)$	7
	3	$T_3^{03}(p,s)$ & $v_3^{03}(p,s)$	18
(h,s)	1	$p_1^{01}(h,s)$ & $T_1^{97}(p,h)$	23
	2	$p_2^{01}(h,s)$ & $T_2^{97}(p,h)$	38
	3	$p_3^{04}(h,s)$ & $T_3^{03}(p,h)$ & $v_3^{03}(p,s)$	10
	4	$T_{sat}^{04}(h,s)$ & $p_{sat}^{97}(T)$ & $x = \frac{h-h'}{h''-h'}$	11
(p,T)	3	$v_3(p,T)$	5

14th ICPWS, Kyoto, 2004

## Computing Time in Comparison with IAPWS-IF97 Fundamental Equations

### Boundary Equations

Funct.	Bound.	Reg.-Reg.	Bound. Eq.	CTR
(p,h)	x = 0	3 - 4	$p_{3sat}^{03}(h)$	12
	x = 1			
(p,s)	x = 0	3 - 4	$p_{3sat}^{03}(s)$	9
	x = 1			
(h,s)	x = 0	1 - 4	$h_1^{04}(s)$	24
		3 - 4	$h_{3a}^{04}(s)$	90
	x = 1	2 - 4	$h_{2ab}^{04}(s)$ , $h_{2c3b}^{04}(s)$	20
		3 - 4	$h_{2c3b}^{04}(s)$	60
	623.15 K	1 - 3	$h_{B13}^{04}(s)$	37
	$p_{B23}^{97}(T)$	2 - 3	$T_{B23}^{04}(h,s)$ , $p_{2c}^{01}(h,s)$	20

Calculation of backward functions including determination of region boundaries

➡ 5 ... 20 times faster than iteration of fundamental equations



Calculations of heat cycles, boilers and steam turbines may be 2... 3 times faster when using the backward and boundary equations

14th ICPWS, Kyoto, 2004

## Conclusions

- IAPWS provides backward and boundary equations for the functions of  $(p,h)$ ,  $(p,s)$ ,  $(h,s)$  and  $(p,T)$
- The equations can be used as a supplement to the Industrial Formulation IAPWS-IF97.
- Their numerical consistencies are sufficient for most applications in heat-cycle, boiler, and steam-turbine calculations.
- Using the equations, the properties as functions of  $(p,T)$ ,  $(p,h)$ ,  $(p,s)$ , and  $(h,s)$  including determination of the region can be calculated without iterations.
- Resulting, process calculations will be between 2 and 3 times faster when using the supplementary backward and boundary equations.
- For applications where the demands on numerical consistency are extremely high, the equations can be used for calculating very accurate starting values in iterations.